



SEE RULE - 18(2)

FORM - (G)

No. F&ES/FPW/219(V) 81/21

Dated Guwahati the 17/2/21

The Principal,
Mother's Pride School,
Narenggaon, Dist:- Dhemaji, Assam.

RENEWAL OF NO OBJECTION CERTIFICATE OF INBUILT FIRE FIGHTING/ FIRE PREVENTION AND MEANS OF ESCAPE MEASURES IN THE MOTHER'S PRIDE SCHOOL AT NARENGGAON, DIST:- DHEMAJI, ASSAM.

With reference to your completion report under No.

NIL

Dated 25.01.2021 I hereby certify that the building as per description below at
Dag No. 158, 159 Patta No. 71 Mouza Dhemaji,
(Place- Narenggaon, Dhemaji) has been inspected in respect of implementation of Inbuilt Fire Fighting/ Fire Prevention/ means of escape measures and is declared fit in respect fire safety. The Fire & Emergency Services, Assam has No objection in its occupation /utilization for the purpose of *SCHOOL* subject to condition mentioned over leaf.

DETAILS OF APPROVED OCCUPATION:-GROUND FLOOR: -1. Floor area: -980 m²2. Purpose of utilization: -
*For School Purpose.*FIRST FLOOR: -1. Floor area: - 980 m²2. Purpose of utilization: -
*For School Purpose.*SECOND FLOOR: -1. Floor area: -980 m²2. Purpose of utilization: -
*Unoccupied.*Details of inbuilt Fire Fighting and Fire Prevention measures:

1. Hose Reel Hose system
2. Down Comer system
3. Manually Operated Electric Fire Alarm system
4. Fire Extinguishers

Amayul
S.P. cum F&ES Adviser,
for and on behalf of
Director of Fire and Emergency Services,
Assam, Guwahati.

Dated Guwahati the _____

NO. F&ES/FPW/

Copy to:-



1. The Deputy Commissioner, Dhemaji, Assam for information and necessary action.
2. The Chairman, Dhemaji Municipal Board, Assam for information and necessary action.
3. The Sr. Station Officer, Dhemaji F&ES Station, for information.

Principal
Mother's Pride School
Dhemaji


Manager
Mother's Pride School
Dhemaji

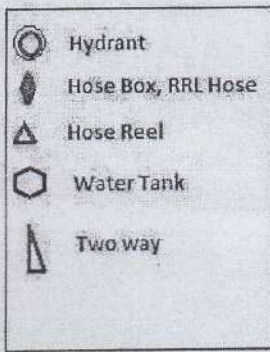
CONDITION:-

1. The N.O.C. is valid up to: - **31.03.2022.**
2. There should not be any change of Trade for which this License has been issued.
3. There should not be any structural change in the building either horizontally or vertically.
There should not also be any change in the existing arrangements.
4. The Fire Fighting equipments should be in serviceable condition at all time.
5. Water reservoir should always be kept full up to brim.
6. The entrance and exit and the water reservoir should always be free from any obstruction/
projection.
7. The N.O.C. is liable to be cancelled if the premises (for which the N.O.C. is granted)
when inspected are not found conforming to the description and condition under
which this N.O.C. is granted.

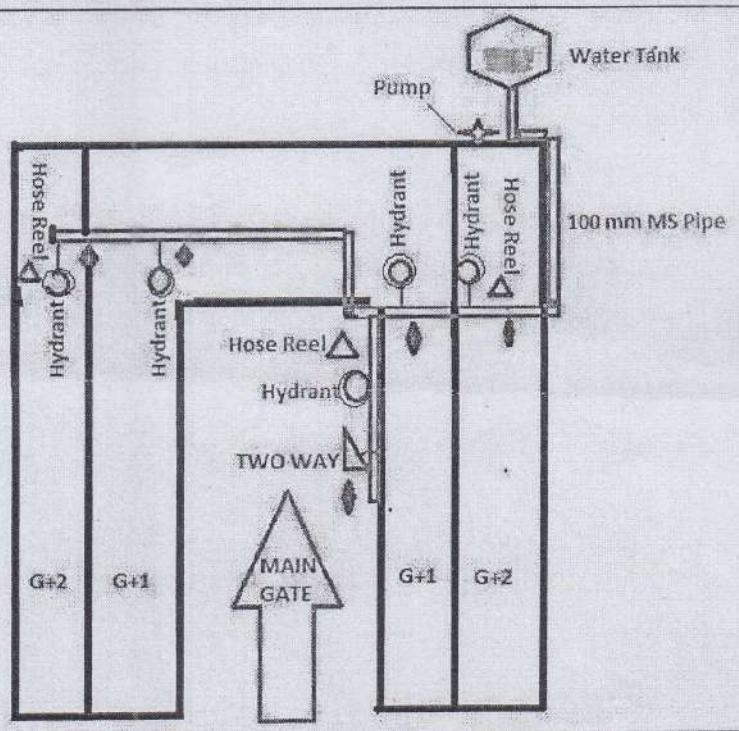

S.P. cum F&E S-Adviser.
for and on behalf of
Director of Fire and Emergency Services.
Assam, Guwahati.



Principal
Mother's Pride School
Dhemaji


Manager
Mother's Pride School
Dhemaji



MOTHER PRIDE SCHOOL
No 1 Nareng Survey Village



FIRE HYDRANT SYSTEM DRAWING, MOTHER PRIDE SCHOOL DHEMAJI

[Signature]
Principal
Mother's Pride School
Dhemaji

[Signature]
Manager
Mother's Pride School
Dhemaji